



**RWANDA
STANDARD**

**DRS
397-6**

First edition

2026-mm-dd

**Use of glass in buildings — Part 6: Code of
practice for Special applications**

ICS 81.040.20

Reference number

DRS 397-6: 2026

© RSB 2026

In order to match with technological development and to keep continuous progress in industries, standards are subject to periodic review. Users shall ascertain that they are in possession of the latest edition

© RSB 2026

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without prior written permission from RSB.

Requests for permission to reproduce this document should be addressed to:

Rwanda Standards Board

P.O Box 7099 Kigali-Rwanda

KK 15 Rd, 49

Tel. +250 788303492

Toll Free: 3250

E-mail: info@rsb.gov.rw

Website: www.rsb.gov.rw

ePortal: www.portal.rsb.gov.rw

Contents

Page

Foreword	v
1 Scope	1
2 Normative references	2
3 Terms and definitions	2
4 Structural sealant glazing	4
4.1 General	4
4.2 Design principles	4
4.2.1 Glass selection	4
4.2.2 Structural sealant selection	4
4.2.3 Bonding	5
4.3 Compatibility of materials	6
4.4 Assembly	6
5 Glazing using structural glass fins	6
5.1 General	6
5.2 Design	6
5.3 Performance of glass with fin supports	7
5.4 Fixing	10
6 Suspended glazing with annealed glass	10
7 Bolt fixed structural glazing	11
7.1 General	12
7.2 Bolt fixing of glass in barriers	13
7.2.1 General	13
7.2.2 Bolt fixing of glass infill panels	14
7.2.3 Base fixing of free standing glass barriers	14
7.3 Frameless doors and door assemblies	16
7.3.1 Toughened glass	16
7.3.2 Frameless plastic doors	19
7.4 Toughened glass suspended assemblies	19
7.4.1 General	19
7.4.2 Design	19
7.4.3 Performance	19
8 Mirrors	20
8.1 General	20
8.2 Safety	20
8.3 Glass mirrors	20
8.3.1 General	20
8.3.2 Mechanical damage	20
8.3.3 Damage by sulfur	21
8.3.4 Damage by alkali	21
8.3.5 Damage by excessive exposure to water	21
8.3.6 Compatibility with fixing materials	21
8.3.7 Fixing methods	21
8.4 Plastics mirrors	22
8.4.1 General	22
8.4.2 Fixing	22

Annex A (informative) Simplified calculation of sealant dimensions for structural sealant glazing 23

A.1 General..... 23

A.2 Symbols 23

A.3 Limitations of the method 24

A.4 Calculation..... 24

Copy for public review only

Foreword

Rwanda Standards are prepared by Technical Committees and approved by Rwanda Standards Board (RSB) Board of Directors in accordance with the procedures of RSB, in compliance with Annex 3 of the WTO/TBT agreement on the preparation, adoption and application of standards.

The main task of technical committees is to prepare national standards. Final Draft Rwanda Standards adopted by Technical committees are ratified by members of RSB Board of Directors for publication and gazettment as Rwanda Standards.

DRS 397-6 was prepared by Technical Committee RSB/TC 9, *Civil engineering and building materials*.

In the preparation of this standard, reference was made to the following standard:

- 1) BS: Glazing for buildings – Part 6: Code of practice for special applications

The assistance derived from the above source is hereby acknowledged with thanks.

DRS 397 consists of the following parts, under the general title *Use of glass in buildings*:

- *Part 1: Terminology*
- *Part 2: General methodology for selection*
- *Part 3: Energy and light*
- *Part 4: Fire and loading*
- *Part 5: Safety related to human impact*
- *Part 6: Code of practice for special applications*
- *Part 7: Code of practice for the provision of information*

Committee membership

The following organizations were represented on the Technical Committee on *Civil engineering and building materials* (RSB/TC 9) in the preparation of this standard.

ASTRIK International

CAMOSAG Ltd

Cleaner Production and Climate Innovation Centre (CPCIC)

DRS 397-6: 2026

Consulting Engineering Group (CEG Ltd)

HOSHAN LTD

Independent Experts

NPD Ltd

Rwanda Housing Authority (RHA)

Rwanda Inspectorate, Competition and Consumer Protection Authority (RICA)

Rwanda Transport development Agency (RTDA)

University of Rwanda – College of Science and Technology (UR-CST)

Rwanda Standards Board (RSB) – Secretariat

Copy for public review only

Use of glass in building — Code of practise — Part 6: Special applications

1 Scope

This Committee Draft Rwanda Standard provides information and recommendations for vertical glazing in the external walls and interiors of buildings, with respect to:

- a) structural sealant glazing;
- b) bolt fixed structural glazing;
- c) frameless doors and entrances;
- d) mirrors;
- e) bolt fixed structural glazing with countersunk holes is not specifically covered.

NOTE Some guidance is also given on non-vertical use of mirrors.

These recommendations do not apply to:

- a) patent glazing;
- b) glass in non-vertical applications;
- c) glazing for furniture and fittings;
- d) glazing for commercial greenhouses;
- e) glazing for domestic greenhouses.

This standard does not specify requirements for workmanship for the application of sealants.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 25537, *Glass in building — Silvered, flat-glass mirror*

RS 397-1, *Use of glass in building — Part 1: Terminology*

RS 397-3, *Use of glass in building — Part 3: Energy and light*

RS 397-4, *Use of glass in building — Part 4: Fire and loading*

RS 397-5, *Use of glass in building — Part 5: Safety related to human impact*

3 Terms and definitions

For the purposes of this standard, the terms and definitions given in RS 397-1 and the following apply.

3.1

glazing (noun)

glass or plastics glazing sheet material for installation into a building

3.2

glazing (verb)

action of installing glass, or plastics glazing sheet materials, into a building

3.3

pane

single piece of glass, or plastics glazing sheet material, in its finished size ready for glazing

3.4

insulating glass unit

assembly consisting of at least two panes of glass, separated by one or more spaces, hermetically sealed along the periphery, mechanically stable and durable

Note 1 to entry: The individual panes may be of different sizes and/or thicknesses.

3.5**plastics glazing sheet material**

plastics material in the form of a single sheet, or a combination of sheets laminated together, or an extruded multi-wall sheet

3.6**sealant bite**

depth of the structural sealant (and also the edge sealant in the case of insulating glass units), as shown in Figure 1, that contributes to the structural adhesion in structural sealant glazing

3.7**vertical glazing**


glazing which is vertical, or within 15° of vertical

3.8**four edge bonded structural sealant glazing**

structural sealant glazing where the pane or insulating glass unit is held in place by the adhesive properties of the structural sealant along all four edges

3.9**two-edge bonded structural sealant glazing**

structural sealant glazing where the pane or insulating glass unit is held in place by the adhesive properties of the structural sealant along two opposite edges and by conventional beaded framing systems on the other two edges

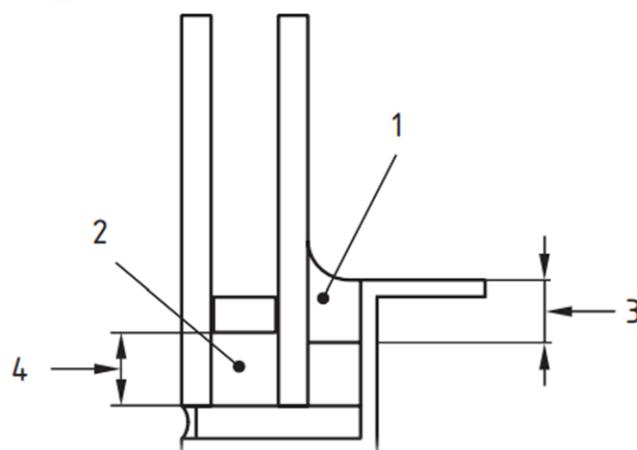

Key

- 1 structural sealant
- 2 IGU edge sealant
- 3 sealant bite
- 4 sealant bite

Figure 1 — Definition of sealant bite in structural sealant glazing

4 Structural sealant glazing

4.1 General

This method of glazing uses the adhesive qualities of silicone sealants to retain the glass in the frame by adhesion, without the necessity of any mechanical retention such as beads, clips or bolt fixings. The system can be either two edge or four edge structural sealant glazing.

A structural seal support frame is mounted onto the glass in a factory, complete with any appropriate setting blocks, location blocks and distance pieces. On site, the support frame is attached to the building structure by mechanical means and sealed.

Figure 2 shows the principles of a structural glazing system.

NOTE Structural glazing is not appropriate for fire resistant glazing.

4.2 Design principles

4.2.1 Glass selection

The type of glass or insulating glass unit should be determined as if it were fully supported on all edges. It is recommended for four edge structural sealant glazing that the inner pane of an insulating glass unit is not manufactured from monolithic toughened glass, since, if this is accidentally fractured, there is a possibility that the rest of the unit will become detached from the adhesive. The glass selection should take into account the likely loading (e.g. see RS 397-4) and safety requirements (e.g. see RS 397-5), and be appropriate for environmental factors (such as thermal insulation, solar control and sound insulation, e.g. see RS 397-3).

4.2.2 Structural sealant selection


The adhesive sealant is the only, or the principal means, of retaining the glazing in position, so the type of sealant is important. Only silicone sealants recommended by the manufacturer should be used.

The sealant bite should be determined from the design loads on the glass and the allowable stress of the sealant. Annex A describes the design method.

With an insulating glass unit, both the edge sealant and the structural sealant serve a structural purpose in retaining the glass in position, and the sealant bite for both of these should be not less than the calculated figure.

The glazing should be designed in such a way that the sealant is only subjected to short duration tensile forces, e.g. wind suction or live loads. Dead loads or sustained loads should be supported by other means, e.g. setting blocks to carry the glass weight (see Figure 2).

The design of the glazing should eliminate shear stresses on the structural sealant.

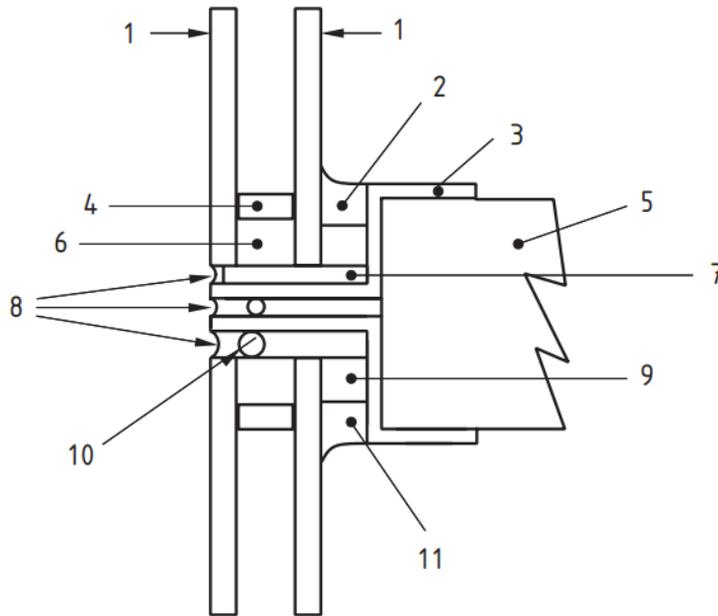

Key

- | | |
|------------------------------------|-----------------------|
| 1 glass | 7 setting block |
| 2 structural sealant | 8 weather seals |
| 3 structural sealant support frame | 9 spacing material |
| 4 spacer bar | 10 backer rod |
| 5 building structure | 11 structural sealant |
| 6 IGU edge sealant | |

Figure 2 — Principles of a structural sealant glazing system

4.2.3 Bonding

The sealant will only perform its function if the adhesive bonds between the sealant and the surfaces of the glass and the sealant and the support frame are adequate and durable. Tests should be performed on the adhesion at all the interfaces with the proposed substrates to ensure that the joint is capable of developing the required strength and that this can be sustained for the expected life of the glazing, assuming regular inspection and maintenance.

Adhesion is product and surface specific. Once the adhesion tests have been completed satisfactorily, the specification for the glass, the support frame, the adhesive sealant and any primers should not be changed.

If any changes are made, the full range of tests should be repeated.

4.3 Compatibility of materials

The insulating glass units should have the edge sealant manufactured from neutral curing silicone.

Care should be taken to ensure that the structural sealant is compatible with the insulating glass unit edge sealant.

Setting blocks, location blocks, weather seals and any other organic materials used in the glazing system should be compatible with the structural sealant and the insulating glass unit edge sealant.

Care should be taken to obtain compatibility between the various sealants and the interlayer of laminated glass.

4.4 Assembly

Assembly of the glass and the support frame should be performed in controlled factory conditions, working to a prepared method statement. The adhesive qualities of the joint can be adversely affected by changes in temperature and humidity or the presence of moisture, so structural glazing adhesive joints should not be made on site.

5 Glazing using structural glass fins

5.1 General

The recommendations of RS 397-3, RS 397-4 and RS 397-5 should be followed in respect of the general selection and design of the glass. 6.2 And 6.3 supplement the recommendations given in those parts.

5.2 Design

Display windows should be designed to resist the expected design wind load (see RS 397-4), but as they may only be subjected to low wind loads, the psychological effects of possible deflections should also be assessed. In the absence of any other loading criteria, or if the wind load is lower than 600 N/m², a minimum wind load of 600 N/m² should be applied.

Where panes in the same plane are butt-jointed without fins, they are not as strong as a single pane of the same overall size and thickness. The butt joint cannot be regarded as a fully supported glass edge. The pane thickness should be calculated by assuming that they are two-edge or three-edge supported, i.e. supported by the surround only.

Depending on the span and wind exposure, glass fins of minimum 15 mm thickness can be necessary, secured to the building structure and bonded to the glazing with a suitable sealant. The adhesive sealant should therefore have sufficient bond strength to resist wind suction whilst allowing for movement. When these conditions apply, the façade panes can be considered to be fully supported on four edges.

The stability and robustness of the rebates and their ability to withstand the effects of wind and glass weight are particularly important in large openings.

Where frames are cantilevered they should be designed to take the weight of the glass when installed. With very large panes it can be necessary to introduce rigid frame supports below the setting block positions to support the weight of the glass. The normal studding type of stall riser framework might be inadequate for this purpose.


Annealed glass fins should not be notched.

5.3 Performance of glass with fin supports


The thickness of the glass for the façade panes, taking account of wind loading, should be determined according to RS 397-4, by considering the panes as fully supported on all four edges. Figure 3 and Figure 4 determine the width and thickness of supporting fins, based on a design stress for the sealant of 0.275 N/mm².

The recommendations of the sealant manufacturer should be followed at all times. Figure 3 and Figure 4 are applicable to installations up to 5 m in height. Above 5 m, the glass supplier should be consulted to determine the suitability of proposals.

To facilitate application of the sealant in a joint, a joint separator of, for example, self-adhesive polyethylene foam strip should be used. It is important to ensure a minimum sealant contact to the fin of 3 mm on each side and the gap between panes should not be less than 3 mm.

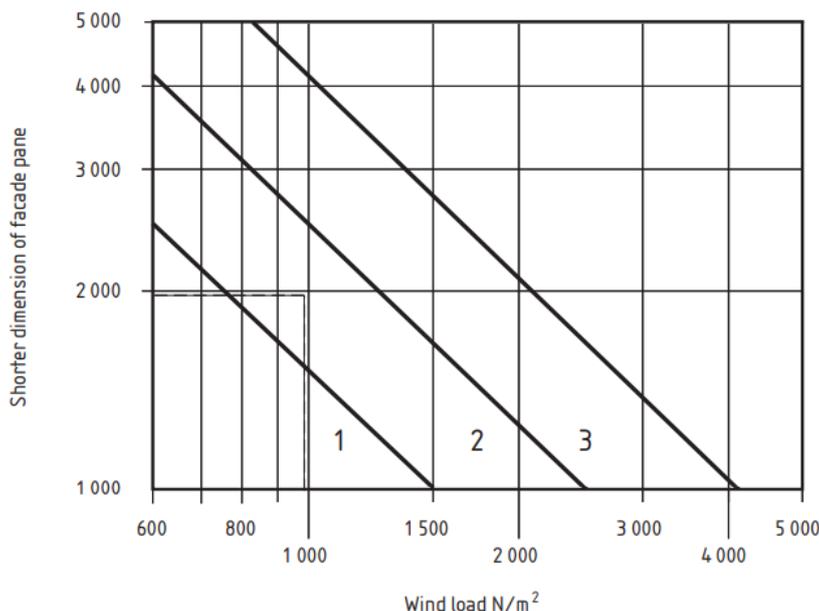


a) Determination of fin thickness

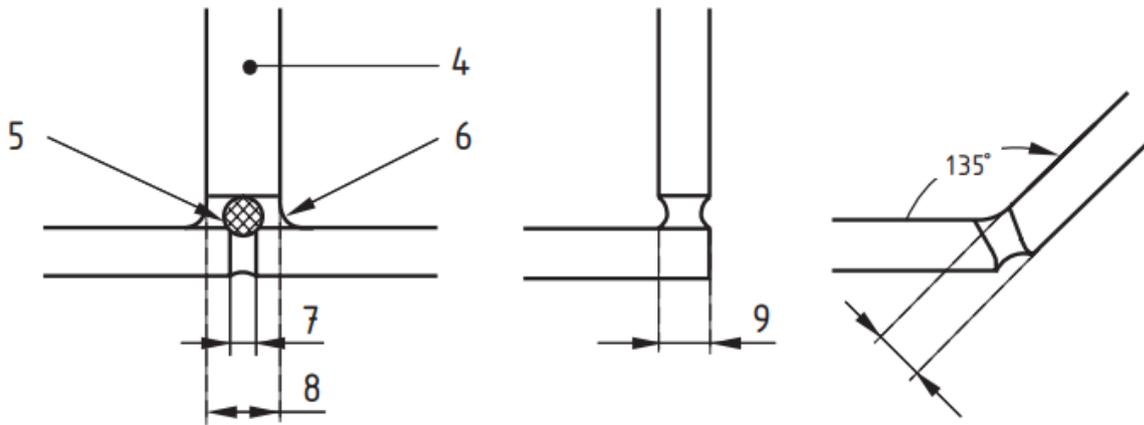

Key

- | | | | |
|---|-----------------|---|---|
| 1 | 15 mm | 6 | high modulus silicone |
| 2 | 19 mm | 7 | gap minimum 3 mm, maximum 9 mm |
| 3 | 25 mm | 8 | minimum thickness |
| 4 | fin | 9 | at least half the minimum fin thickness |
| 5 | joint separator | | |

Figure 3 — Fin thickness

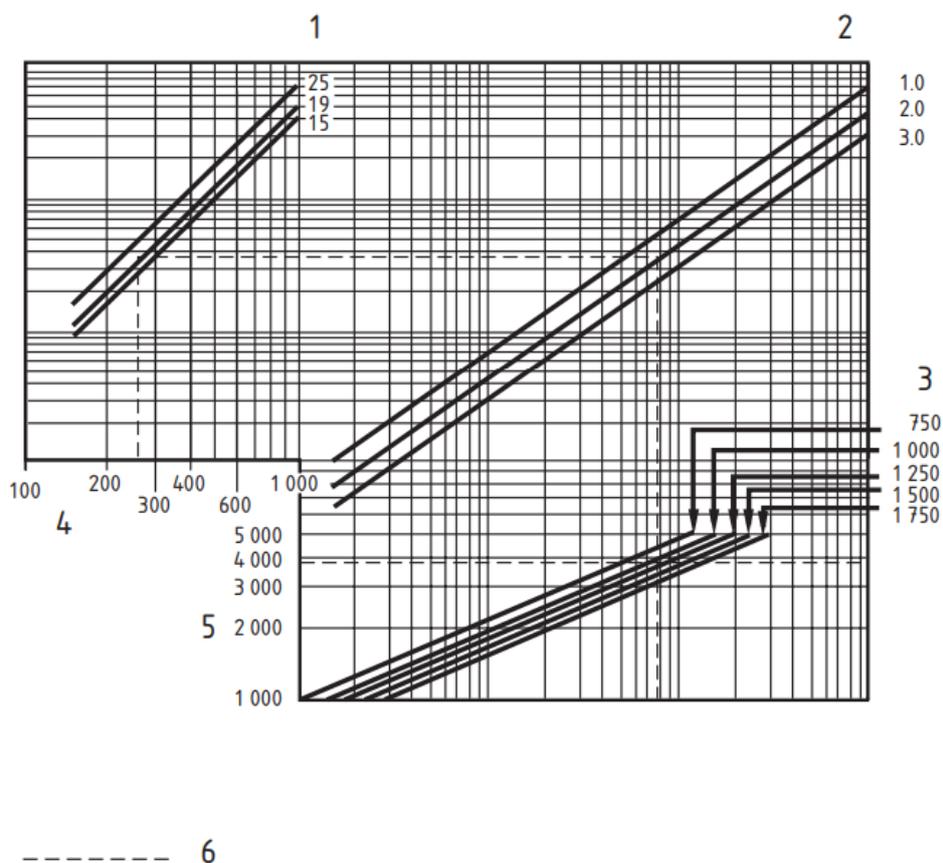

Key

- | | | | |
|---|---|---|------------------|
| 1 | fin thickness | 4 | fin width |
| 2 | aspect ratio = $\frac{\text{pane height}}{\text{pane width}}$ | 5 | fin weight |
| 3 | wind loading | 6 | indicate example |

Figure 4 — Determination of annealed float glass fin width to resist the design wind load

EXAMPLE

The following example illustrates the use of Figure 3 and Figure 4.

- Design brief. A pane 2 000 mm wide × 4 000 mm high in a shop front, that has an area of 8 m², an aspect ratio of 2:1, and a fin height of 4 000 mm. The pane has to withstand a wind loading of 990 N/m².
- Determination of pane thickness. For an area of 8 m², to withstand a wind loading of 990 N/m², RS 397-4 shows that 10 mm float glass, 10 mm laminated glass or 6 mm toughened glass will withstand the wind load.

- c) Determination of fin thickness. In Figure 3, the strength of an adhesive sealant joint depends on the width (and hence area) of the fin edge fixed to the glass it is required to support. The minimum fin thickness is given by the diagonal line to the right of the intersection of the horizontal line representing the smaller dimension of the façade pane and the vertical line representing wind loading.
- d) In this example, a pane of smaller dimension 2 000 mm to withstand a wind loading of 990 N/m² requires a fin thickness of 19 mm (see broken line in Figure 3).
- e) e) Determination of fin width. Referring to Figure 4 and knowing the height of the fin, the wind loading, the aspect ratio (between the height of the fin and the width of the glass which it is to support) and the fin thickness, then the width of the fin can be determined.
- f) For a fin 4 000 mm high having to withstand a wind loading of 990 N/m², where the aspect ratio is 2:1 and the fin thickness is 19 mm, the width of the fin is found to be 260 mm (see broken lines on Figure 4).

NOTE If desired, the fin width can be determined by calculation from the following formula.

$$d = \frac{1}{1000} \left\{ \frac{6P_s^3}{17.8t} X \frac{\left(1 - \frac{1}{3r^2}\right)}{8r} \right\}^{0.5}$$

where

d is the fin width (mm);

P is the wind load (N/m²);

s is the fin height (mm);

t is the fin thickness (minimum tolerance for the glass) (mm);

r is the ratio of fin height to pane width (if $r < 1.0$ then r should be set as 1.0).

Where a glazed area, without mullions, includes right-angled returns or has butting panes with the internal angle not exceeding 135°, panes may be mitre bevelled and joined by a suitable adhesive sealant without the need for additional support, provided the size of the joint is similar to that shown in Figure 3. Each of the two panes meeting at the angle may be considered as fully supported along that edge and also satisfying the wind loading recommendations of RS 397-4.

5.4 Fixing

Any of the glazing methods described in this Standard, employing beads or structural gaskets, may be applied to the edges of the façade panes. A suggested design for a fin support box is shown in Figure 5.


6 Suspended glazing with annealed glass

When glazed conventionally, glass has to support its own weight, and for very tall panes this can result in considerable stress being induced. By suspending the glass from above, such stress can be eliminated and

settlement or other movement of the main structure of a building can be accommodated. Annealed glass can be suspended by two sets of clamps attached to the glass by a combination of a suitable adhesive and mechanical pressure, thus avoiding drilling or notching, which almost inevitably leads to breakage of annealed glass when it is subjected to applied loads.

This system of suspending glazing should be carefully designed to ensure optimum performance and it is essential that the specialist glazier is consulted at an early stage in the development.

The vertical edges of such suspended glass should be supported against wind loading. This can be achieved by a conventional mullion system, provided that the glass is allowed to “ride” in the rebates when deflection takes place, or by the use of glass fins mechanically joined to the panes. In certain conditions this can be achieved by joining with sealant, but for exposed situations, particularly where a high degree of movement is expected, a combined glass and metal bar might be necessary.

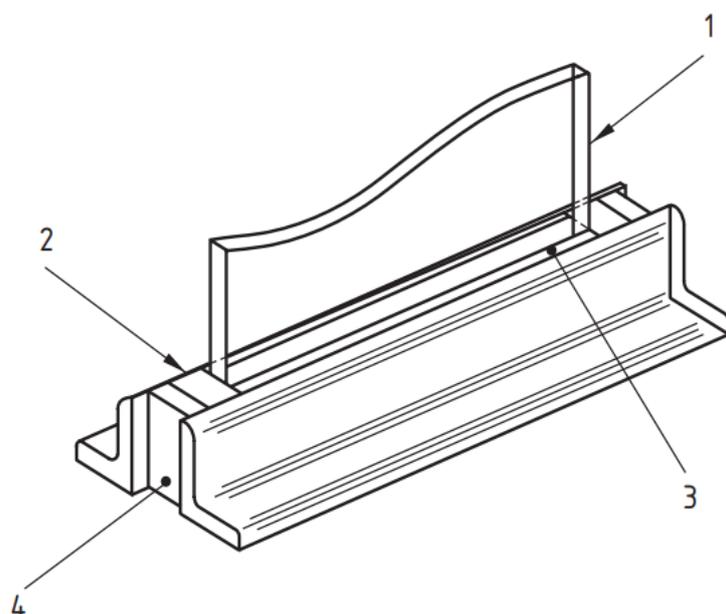

Key

- | | | | |
|---|---------------------------|---|--------------------------------------|
| 1 | glass fin | 3 | 10 mm hardwood packing |
| 2 | 25 mm hardwood thrust pad | 4 | welded fin box with steel base plate |

Figure 5 — Fin support box

The glass fin should be on poly-chloroprene to ensure no contact with the metal base plate of the bottom fin box. For a top fin box the base plate and poly-chloroprene should be omitted to allow adequate clearance at the top of the fin.

7 Bolt fixed structural glazing

NOTE This information only applies to monolithic thermally toughened soda lime silicate safety glass. Information on the use of laminated thermally toughened soda lime silicate safety glass can be obtained from

the



manufacturer.

7.1 General

Use of bolts to fix through glass will inevitably result in stress concentrations around the bolt holes. These are a weak point in annealed glass, because drilling or notching almost inevitably leads to breakage of annealed glass when it is subjected to applied loads. Toughened glass should be specified where bolt fixings in glass are to be used.

The frame and/or fixings should always be designed so that they do not tend to distort the glass panel. This is more important with bolted connections, which can exert considerable forces on the glass, where particular attention should be paid to the alignment and position of the fixings in order to avoid unnecessary stresses being developed.

A bolted fixing will generally consist of two metal spreader plates (e.g. see Figure 6), one of which is attached to the structure, with one or more bolts passing through the glass and clamping it between the spreader plates. The spreader plates should be separated from the glass by a gasket that should preferably be not more than 1 mm thick and incompressible (e.g. vulcanized fibre gasket — not polychloroprene gasket). A nylon, or similar, incompressible bush 2 mm to 3 mm thick should be used to prevent the bolt from contacting the edges of the hole. The hole in the glass should be at least 10 mm larger in diameter than the bolt passing through it, to allow for tolerance adjustment and the presence of a bush. The spreader plate should give a minimum of 15 mm cover to the glass around the hole when the bolt is centrally positioned in the hole.

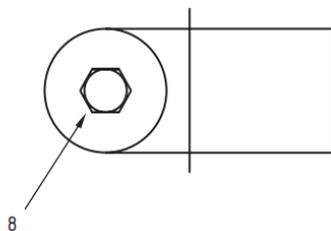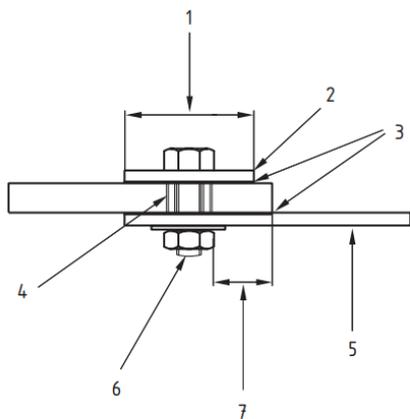

Key

- | | |
|--|---|
| 1 diameter = glass hole diameter + 30 mm | 5 spreader plate fixed to structure |
| 2 spreader plate | 6 bolt tightened to maximum torque |
| 3 1 mm incompressible fibre gaskets | 7 minimum 2 × glass thickness |
| 4 nylon or hard plastic bush, 2 mm to 3 mm thick | 8 glass hole diameter = bolt diameter +10mm |

Figure 6 — Principles of a toughened glass infill panel bolted connection

The bolt size, spreader plate diameter and spreader plate thickness should be chosen to suit the specific design of the glazing. The design should ensure that the glazing can carry the anticipated loads without the glass fracturing and without excessive deflection.

The general relationship between the components of a bolted fixing can be determined after the appropriate size of bolt has been chosen. The thickness of the spreader plate should be about 75 % of the bolt diameter, but not less than 6 mm. The diameter of the spreader plate should be about eight times its thickness.

Table 1 gives a brief summary of the relationship.

Table 1 — Relationship between bolt size, spreader plates and glass thickness

Loading	Bolt diameter	Spreader plate		Toughened glass thickness mm
		Diameter mm	Thickness mm	
Light	M6	50	6	8
Normal	M6, M10	50	6	8,10 ^a
Heavy	M10	60	8	10,12
	M12	75	10	12,15
	M16	100	12	15,19,25

^a For bolted fixings used simply to locate a pane in position, not intended to form a clamp and resist applied bending moments, then the fixing for normal loading should be appropriate for all thicknesses of toughened glass.

7.2 Bolt fixing of glass in barriers**7.2.1 General**

The barrier and the glass panels should be designed to meet the recommendations of the approved standard.

7.2.2 Bolt fixing of glass infill panels

At the bolted connections there should be clamping plates and gaskets (see 7.1) on both sides of the glass, a minimum of 50 mm diameter. These plates should be not less than 6 mm thick in steel or an equivalent stiffness in other materials. Figure 6 shows a typical fixing.

Where the length of a glass pane is much greater than the span between the bolted connectors, giving rise to a cantilevered portion of the pane, the cantilevered portion should be less than one-quarter of the span between the bolted connectors.

Under the design loads, the barrier should be designed such that the relative in-plane movement of the bolted connections in the same panel is not greater than 2 mm.

7.2.3 Base fixing of free standing glass barriers

7.2.3.1 Localized fixing clamps

The fixing clamps on each side of the glass should be not less than 100 mm × 150 mm and be made of 12 mm thick steel or an equivalent stiffness in other materials.

There should be not less than two fixing clamps for every 1 000 mm length of barrier.


Figure 7 shows a typical localized fixing clamp.

7.2.3.2 Continuous fixing clamps

The fixing clamps on each side of the glass should be not less than 100 mm wide and be made of 12 mm thick steel or an equivalent stiffness in other materials.

The clamps should be continuous for the entire length of the glass pane and have a maximum bolt spacing of 500 mm.

Figure 8 shows a typical continuous fixing clamp.

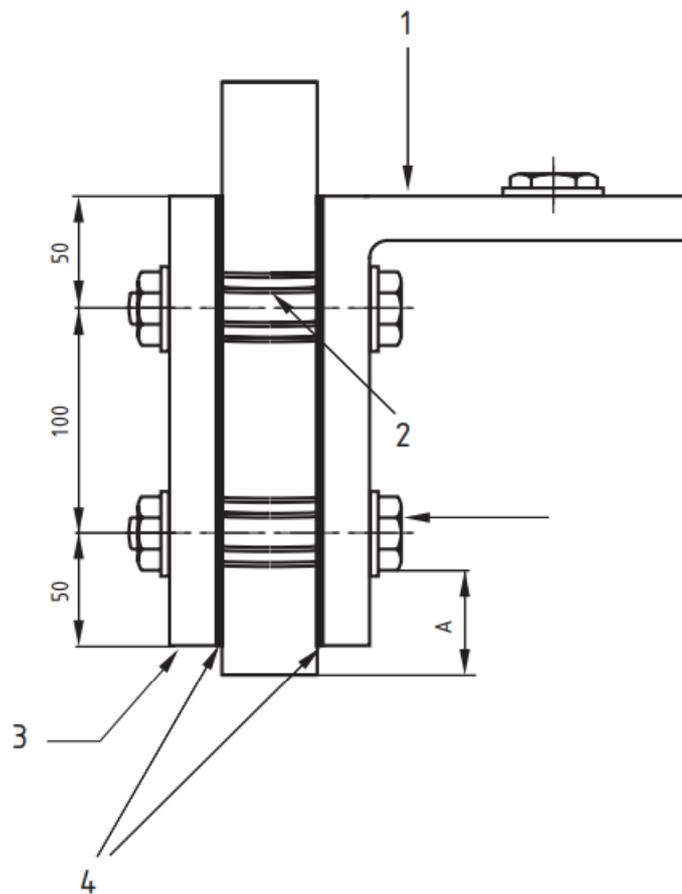


Key

- 1 100 mm wide 200 × 200 × 12 RSA
- 2 3 mm thick nylon or similar bush
- 3 steel clamp plate 12 mm thick × 100 mm wide
- 4 1 mm incompressible gaskets

NOTE 1 A = minimum 2 × glass thickness from edge of glass to edge of hole.

NOTE 2 Glass hole diameter = bolt diameter + 10 mm.

Figure 7 — Typical localized fixing clamp for free standing glass barrier

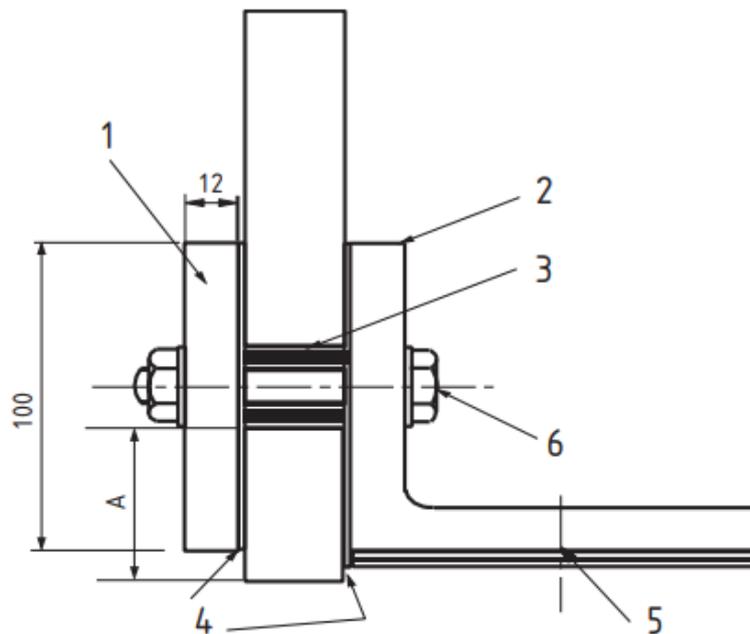

Key

- 1 continuous steel plate
- 2 continuous 100 × 100 × 12 RSA
- 3 mm thick nylon or similar bush
- 4 1 mm incompressible gasket
- 5 fixing bolts sufficient to resist turning moment
- 6 M16 bolts torqued to 125 N*m at 500 mm centres maximum

NOTE 1 A = minimum 2 × glass thickness from edge of glass to edge of hole.

NOTE 2 Glass hole diameter = bolt diameter + 10 mm

Figure 8 — Typical continuous fixing clamp for free standing glass barrier

7.3 Frameless doors and door assemblies

7.3.1 Toughened glass

7.3.1.1 General

The recommendations in RS 397-3, RS 397-4 and RS 397-5 should be followed. The recommendations given in 7.3.1.2 and 7.3.1.3 supplement the recommendations given in these parts.

Toughened glass doors are usually specially designed for a particular location and the manufacturer should be consulted.

Full details of all aspects of toughened glass door installations and assemblies should be considered at an early stage of the design.

However, Table 2 gives guidance on appropriate toughened glass thicknesses for normal applications.

Table 2 — recommended frameless toughened door thicknesses

Length of door diagonal mm	Thickness of toughened glass mm
k 1 700	8
> 1 700 and k2 500	10
> 2 500 and k3 300	12

7.3.1.2 Exterior doors


Transparent and translucent glass doors for exterior use are normally fitted with rails and/or patch fittings at the top and/or bottom edges. Matching side panels and transoms may be used to fill the entire opening in an assembly securely fixed with patch fittings and toughened glass supporting fins as required.

7.3.1.3 Interior doors

Transparent and translucent glass doors for interior use are normally fitted with patches at top and bottom corners, from which the doors are pivoted, or with hinges. Pivoted doors may be provided with matching side and transom panels as for exterior doors, thereby filling an opening in an assembly fixed with patch fittings and toughened glass supporting fins as required.

7.3.1.4 Cantilever fin support fixings

Where toughened glass supporting fins are cantilevered from the upper structure of an opening, the fins should be clamped in a friction grip bolted system as shown in Figure 9. The distance between the bolts, indicated by d in Figure 9, should be determined depending on the door height, the spacing of the fins, the length of the fins and the applied loadings, but should be not less than 100 mm.

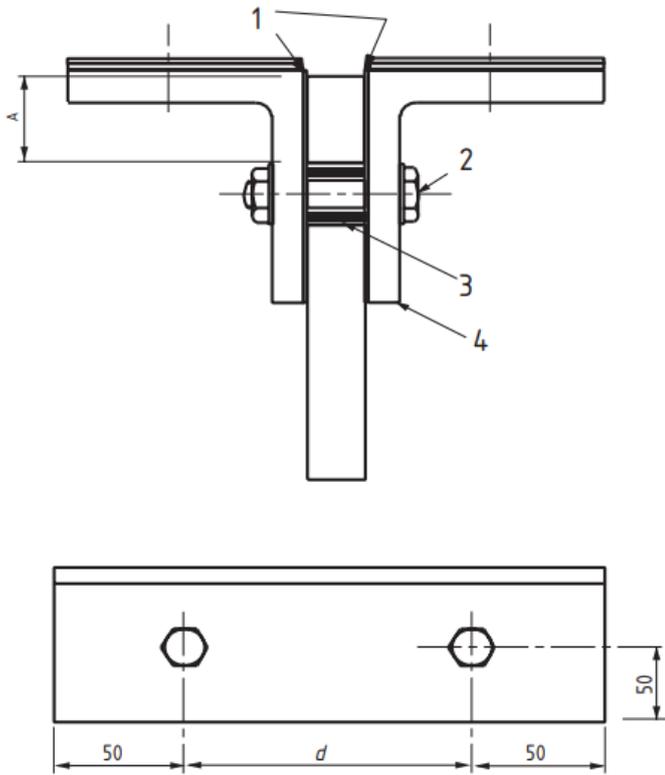

only

Key

- 1 1 mm thick incompressible gasket
- 2 grade 8.8 M16 bolts tightened to 240 N·m torque
- 3 3 mm thick nylon or similar bush
- 4 12 mm thick 125 × 125 RSA

Figure 9 — Principles of a cantilever fin support

Table 3 gives the suggested bolt separation for a standard width and height double door configuration (2 × 900 mm × 2 100 mm, where the 2 represents the two doors), with a cantilevered fin supporting the upper corners of the door opening, when the design wind load does not exceed 1 000 N/m².

Table 3 — Spacing of bolts in cantilevered fin support systems

Length of fin mm	Spacing between fin support bolts, (see Figure 9) mm
600	100
800	100
1000	110
1200	140

7.3.2 Frameless plastic doors

7.3.2.1 General

The recommendations in RS 397-3, RS 397-4 and RS 397-5 should be followed. The recommendations given in 8.3.2.2 supplement the recommendations given in those parts.

7.3.2.2 Design

Frameless plastics doors may have panels fitted to the bottom edge and, where handles are not used, over the area contacted by the hand. Corners and exposed edges of doors should be rounded.

Hinges and locks should not be attached by systems that require screw threads to be tapped in the plastics sheet material. If bolts are used, the perimeter of the clearance holes should be at least 35 mm from any edge. The bolts should not be over-tightened and the recommendations of the plastics glazing sheet materials manufacturer on hole drilling and bolt assembly should be followed.

7.4 Toughened glass suspended assemblies

7.4.1 General

The recommendations in RS 397-3, RS 397-4 and RS 397-5 should be followed. The recommendations given in 8.4.2 and 8.4.3 supplement the recommendations given in those parts.

7.4.2 Design

Suspended glass assemblies consist of a series of toughened glass panes secured together at their corners, and can be designed to provide a method of glazing large openings in buildings without the use of full height mullions.

The façade so produced is hung from the building structure by its top edge and sealed to the building. The gaps between the panes can be sealed.

Support against wind loads is provided by toughened glass fins fixed at vertical joints on the façade and are secured to the building fabric and to each pane corner fitting. The fins may be cantilevered or continuous, according to design and aesthetic considerations.

7.4.3 Performance

It is the responsibility of the architect and/or structural engineer of a project to ensure that the building structure is able to support the load of the suspended glass. The following should be determined prior to a project study being undertaken:

- a) opening size;

b) design wind loading;

c) Deflections of the structure under wind, live and dead loads.

8 Mirrors

8.1 General

Mirrors should conform to the requirements of ISO 25537.

NOTE 1 Opaque, decorative glass or plastics facings can generally be fixed in the same way as mirrors and require the same care and precautions.

8.2 Safety

The mirror should meet the safety glazing provisions and recommendations of RS 397-5.

NOTE For all non-vertically fixed mirrors, including those for overhead use, additional care is needed. Even if the mirror is made from safety glazing, that is, the glass or plastics glazing sheet material conform to the approved Standard, it is essential that it is also fixed by a method that substantially retains the pieces in place against the ceiling or backing panel if it is broken. A material conforming to the approved standard and having no sharp edges or points might still cause injury if either the whole pane, or fragments of appreciable weight, can fall through a significant height.

8.3 Glass mirrors

8.3.1 General

Wherever the edge of the mirror is visible (as opposed to being under a bead or other feature overlapping the cut edge) then the edge should be ground or arressed to minimize the risk of injury. 8.3.2 to 8.3.6 indicate precautions to be taken to limit various problems when fixing mirrors.

NOTE Glass mirrors for non-vertical applications require special consideration.

8.3.2 Mechanical damage

Mirrors can be distorted or broken when being forced into clips or screwed down too tightly. Where local irregularities occur in the surface to which the mirror is to be fixed, they should be overcome by the use of compensation washers, and for large areas of irregularity the mirror should be bedded on to a minimum thickness of 5 mm of fixing compound.

Screws should be prevented from coming into contact with the glass by sleeves and washers made of fibrous material, hard nylon or similar. The holes in the glass should therefore be large enough to accommodate both sleeves and screws.

Adjacent glasses should never be butt jointed. There should always be a clearance of at least 1 mm maintained by inserting a suitable separating material.

8.3.3 Damage by sulfur

Some building materials, e.g. clinker blocks and certain fixing media, such as latex cement, contain sulfur. This can attack the metal layers of mirrors and a barrier between the supporting structure and the mirror back might be required. Polyethylene sheet is a recommended barrier material.

Care should also be taken to ensure that any sleeve or washer materials do not contain sulfur compounds, as these migrate through the protective mirror backing and attack the silver film.

8.3.4 Damage by alkali

Where a mirror is to be in contact with mortar, concrete or plaster, it is liable to damage by alkali, which can attack any unprotected backing paint of a mirror. A barrier layer, e.g. lead or aluminium foil, might be required. Alternatively, the risk of alkali attack can be largely avoided by spacing the mirror from the wall, leaving a gap of 3 mm to 5 mm.

8.3.5 Damage by excessive exposure to water

In places where high humidity occurs, as in bathrooms and kitchens, provision should be made for the free circulation of air behind the mirror, to prevent deterioration from protracted exposure to water vapour.

This can be achieved by using distance pieces (washers where screws are used, and packing pieces behind clips) to leave a gap of 3 mm to 5 mm.

8.3.6 Compatibility with fixing materials

Where mirrors are to be fixed with mastic, a suitable product should be chosen that will not attack the backing paint and silvering of the mirror. The wall surface should also be sealed to prevent oil absorption from the mastic.

It should be ensured that any other fixing materials, e.g. silicones, solvent based sealants, are compatible with the mirror backing paint and metal layers.

8.3.7 Fixing methods

Mirrors may be fixed in any one of the following ways:

- a) Directly to a permanently dry background (as in a living room), or to an independently fixed backboard, using clips or screws with decorative covers.

For all mirrors over 1 m² in area and fixed by clips or screws, additional support adequate to carry the weight of the mirror should be provided at the bottom edge by, for example, supplementary clips, anchors or a fixing bead.

For overhead fixing of mirrors the use of screws through drilled holes is not recommended. Solid fixing, and the use of a retaining bead wherever possible, is the preferred method for overhead and/or high level installation of mirrors.

- b) With a freely ventilated airspace between the mirror and the wall, using clips or screws with spacing washers or packing pieces.
- c) With edge beads, either to a flat surface or on battens spaced not more than 400 mm apart. The battens should be sealed and fixing compounds used as a bedding.
- d) To a backboard using an adhesive. The manufacturer should be consulted. To protect the backing paint, silver and adhesive from timber backboards, the timber should first be sealed.
- e) To a flat background using foam self-adhesive strips or pads applied directly to the backing paint. The mirror manufacturers should be consulted. This method of fixing should be limited to mirrors up to 1 m² in area and should never be used in overhead or high level situations.

8.4 Plastics mirrors

8.4.1 General

Plastics sheet mirrors are frequently used in areas where impact resistant properties are of importance or in those situations where a material is required that can be easily cut and drilled.

Plastics sheet mirrors can be subject to significant dimensional changes caused by variations in ambient temperature or moisture content, so fixing systems should be capable of accommodating any dimensional changes that might occur after installation.

Most plastics sheet mirrors are coated on the rear surface with a lacquer to protect the mirrored finish.

Adhesives used for attachment should not contain solvents that could damage the protective coating.

8.4.2 Fixing

Plastics sheet mirrors can be fixed directly to a wall by screws. To allow for dimensional changes, screw holes should be made oversize. Minimum pressure should be used when tightening screws to prevent optical distortion of the mirror.

Plastics sheet mirrors can also be fixed to walls by double-sided adhesive foam tape.

NOTE Either of the above methods can be used to attach plastics sheet mirrors to ceilings. For ceiling fixtures using double-sided adhesive foam tape it is recommended that at least 30 % of the sheet area is covered by tape.


Any frame used to hold a mirror should be capable of accommodating dimensional changes.

Annex A (informative)

Simplified calculation of sealant dimensions for structural sealant glazing

A.1 General

This method is used to define the dimensions of the structural sealant as shown in Figure A.1.

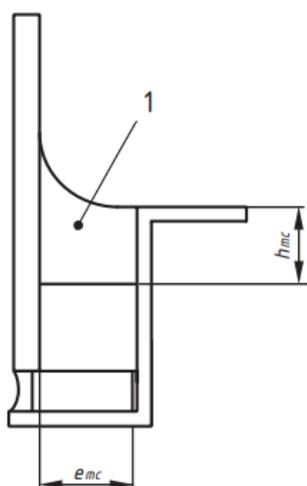

Key

1 Structural sealant

Figure A.1 — Structural sealant dimensions

A.2 Symbols

a	Shorter dimension of pane (m)
e_{mc}	Thickness of structural sealant (mm)
h_{mc}	Structural sealant bite (mm)
l	Length of side considered (m)
R	Characteristic stress of structural seal (N/mm ²)
w_g	Central deflection of the glass under load (m)

w_d	Design wind pressure (N/m ²)
α_f	Thermal expansion coefficient of frame
α_g	Thermal expansion coefficient of glass
Δt_f	Average temperature change of frame
Δt_g	Average temperature change of glass

A.3 Limitations of the method

The simplified calculation is applicable provided:

$$w_g \leq \frac{a}{100} \text{ and } \frac{h_{mc}}{2} \leq e_{mc}$$

A.4 Calculation

The minimum dimensions of the structural sealant are given by the two following equations:

$$h_{mc} = \frac{w_d a}{2\alpha_d}$$

$$e_{mc} = \frac{\Delta l}{0.15}$$

where

$$\Delta l = l(\alpha_f \Delta t_f - \alpha_g \Delta t_g)$$

and

$$\alpha_d = \frac{R}{4}$$

If the value of e_{mc} derived from the above calculation is less than half the value of h_{mc} , then the minimum value of e_{mc} is $h_{mc}/2$.

Bibliography

- [1] BS 5502-21:1990, *Buildings and structures for agriculture — Part 21: Code of practice for selection and use of construction materials*
- [2] BS 5516-1:2004, *Patent glazing and sloping glazing for buildings — Part 1: Code of practice for design and installation of sloping and vertical patent glazing*
- [3] BS 5516-2:2004, *Patent glazing and sloping glazing for buildings — Part 2: Code of practice for sloping glazing*
- [4] BS 6206:1981, *Specification for impact performance requirements for flat safety glass and safety plastics for use in buildings*
- [5] BS 6262-2:2005, *Glazing for buildings — Part 2: Code of practice for energy, light and sound*
- [6] BS 6399-1:1996, *Loading for buildings — Part 1: Code of practice for dead and imposed loads*
- [7] BS 6399-2:1997, *Loading for buildings — Part 2: Code of practice for wind loads*
- [8] BS 6399-3:1988, *Loading for buildings — Part 3: Code of practice for imposed roof loads*
- [9] BS 7376:2004, *Specification for inclusion of glass in the construction of tables or trolleys*
- [10] BS 7449:1991, *Specification for inclusion of glass in the construction of furniture, other than tables or trolleys, including cabinets, shelving systems and wall hung or free standing mirrors*
- [11] BS EN 1279-1:2004, *Glass in building — insulating glass units — Part 1: Generalities, dimensional tolerances and rules for the system description*
- [12] EN 13022-1:2002, *Glass in building — Structural sealant glazing — Part 1: Glass products for structural sealant glazing systems — Supported and unsupported — Monolithic and multiple glazing*
- [13] EN 13022-2:2003, *Glass in building — Structural sealant glazing — Part 2: Assembly rules*
- [14] EOTA, *Guideline for European Technical Approval for structural sealant glazing systems (SSGS)*
- [15] *European Organisation for Technical Approvals (EOTA). Brussels, 2000.1)*

Copy for public review only

Price based on 24 pages

©RSB 2026 - All rights reserved